



recycled water update

Ararat

Report for June 2026

11 McLachlan Street
(PO Box 481)
Horsham Victoria 3402

Storage levels

Tel: 1300 659 961



5381 9881


water.org.au

water.org.au

9 standards

S/NZS 4801

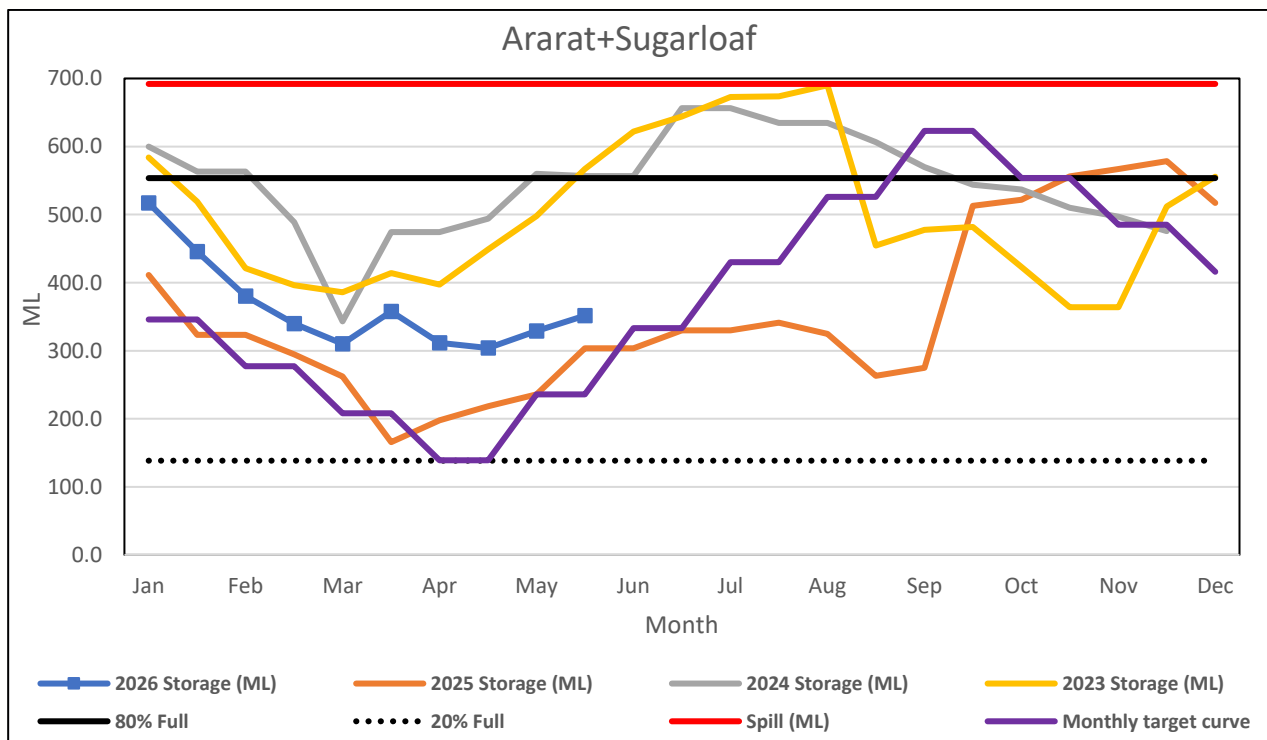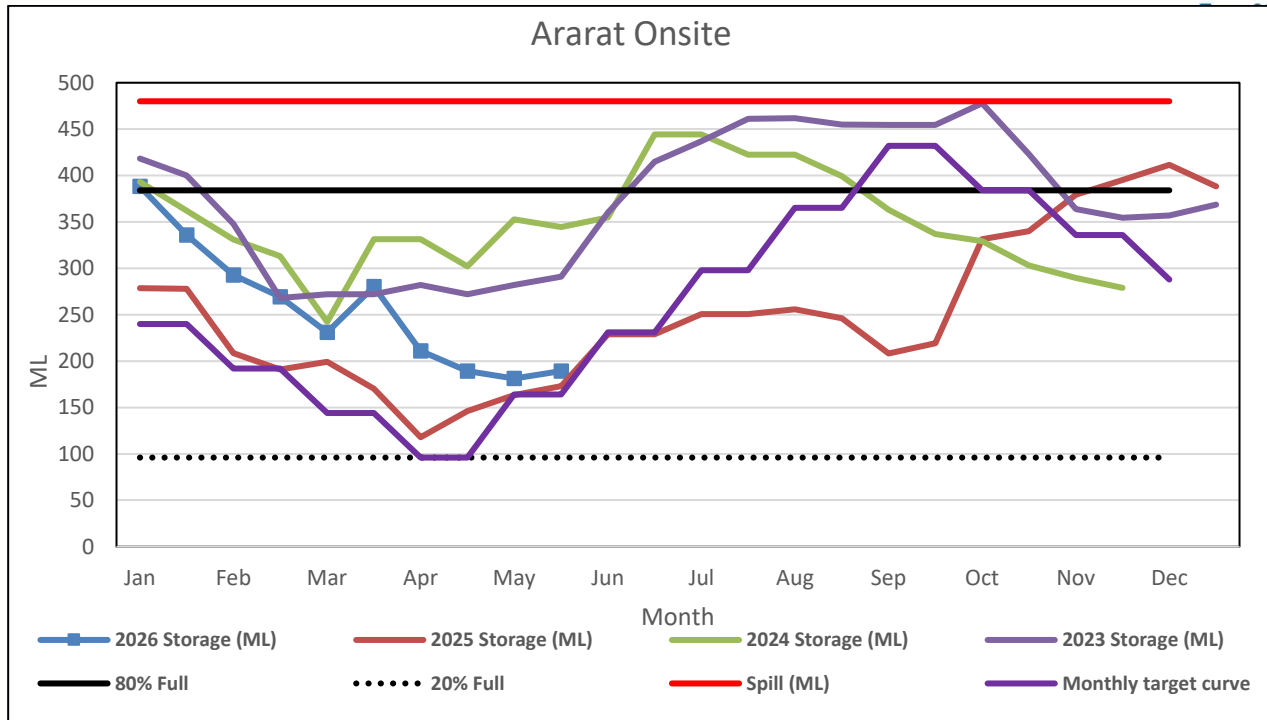

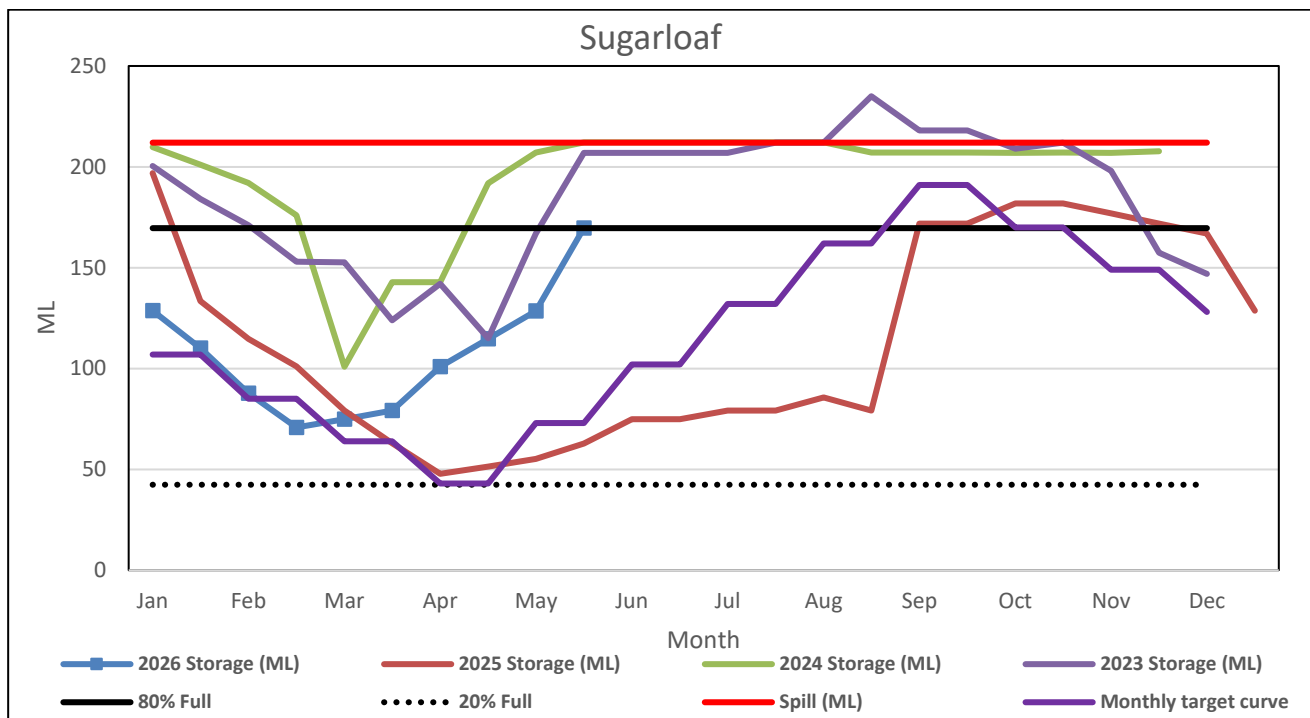

Recycled Water Quality

Ararat winter storage onsite:

The test results for the month meet Class “C” requirement.

Parameter	Wet Weather Storage	EPA Compliance levels Class C water*
pH	7.6	6-9
Biochemical Oxygen Demand (mg/L)	13.0	<20
Suspended Solids (mg/L)	6.0	<30
E.coli (orgs/100ml)	60.0	<1000
Total Phosphorus (mg P/L)	16.0	
Total Nitrogen (mg N/L)	10.0	
Sodium (mg P/L)	220.0	
Sodium Adsorption Ratio (mg N/L)	8.8	
Electrical Conductivity (uS/cm)	1400.0	

* Parameters for Class C Water

(EPA, Victorian guideline for water recycling. Publication 1910.2. March 2021).